| DRAWING: | JD250-02-HSD |
|---|---|

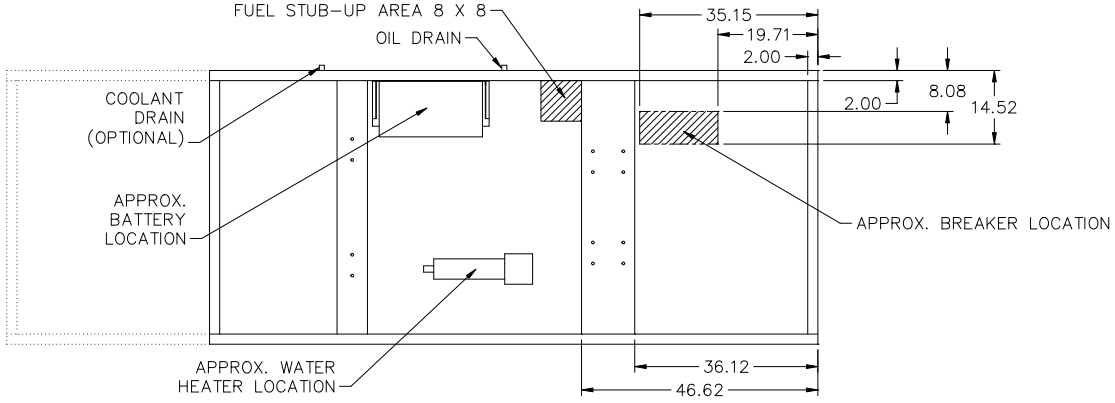


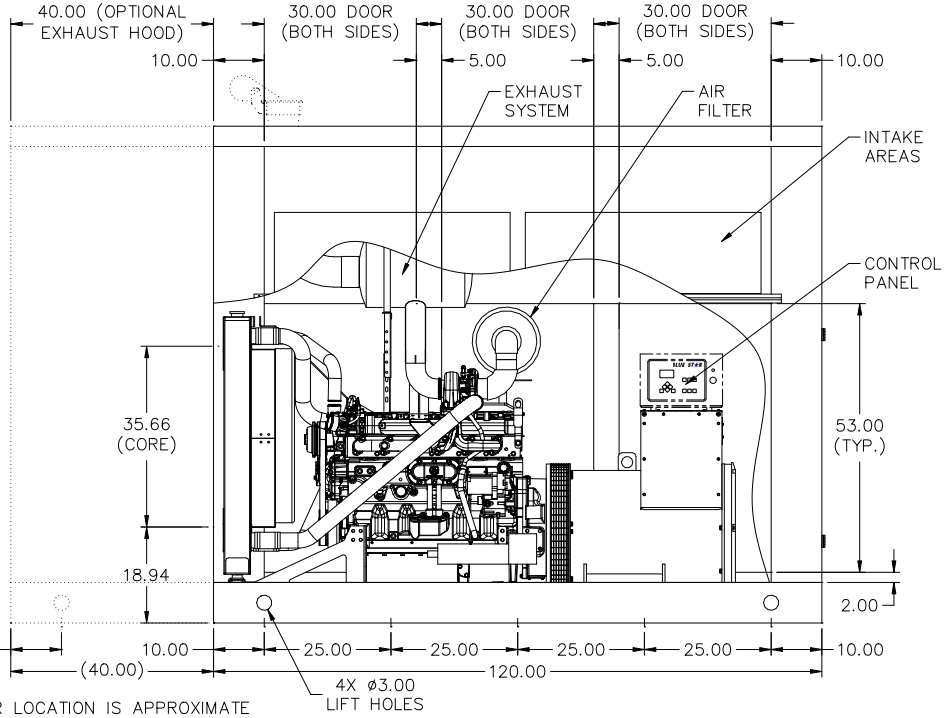


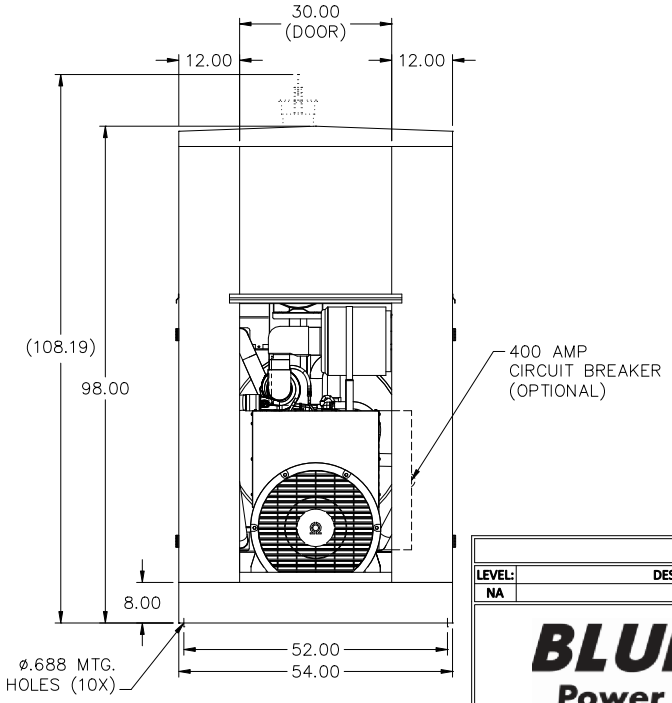


NOTES:
1. BREAKER LOCATION IS APPROXIMATE
2. RADIATOR CORE WIDTH: 39.16"
3. FUEL SUPPLY: 1/2" FUEL RETURN: 3/8"
5. (OPTIONAL): EXHAUST HOOD INCLUDED LEVEL 3 ENCLOSURE ONLY
6. (OPTIONAL): EXHAUST ROUTED THROUGH EXHAUST HOOD LEVEL 3 ENCLOSURE ONLY
7. (OPTIONAL): SOUND ATTENUATION FOAM INCLUDED LEVEL 2 & 3 ENCLOSURES ONLY
8. (XX.XX) DIMENSIONS ARE FOR REFERENCE ONLY

REVISIONS:

| LEVEL: | DESCRIPTION: | DATE: | BY: |
|---|---|---|---|
| NA | NA | NA | NA |

BLUE STAR Power Systems Inc.

| | | | |
|---|---|---|---|
| ENG: 6090HF484 | GEN: 432 | | |
| RAD: DR3096 | BASE: 2-0018 | HSG: WPF-017 | |
| DATE: 12-29-15 | BY: KAP | DRAWN TO SCALE | |