
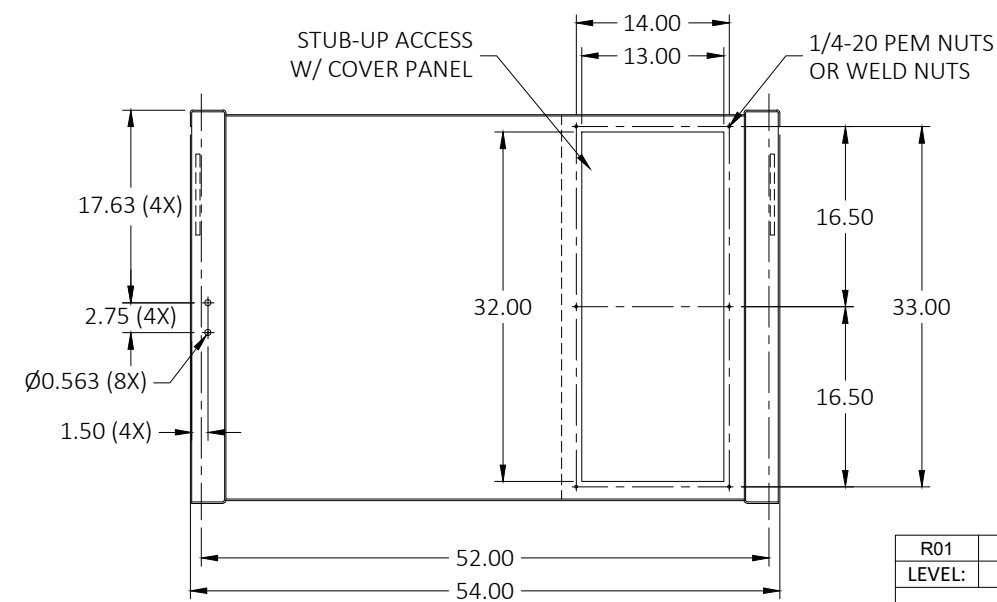
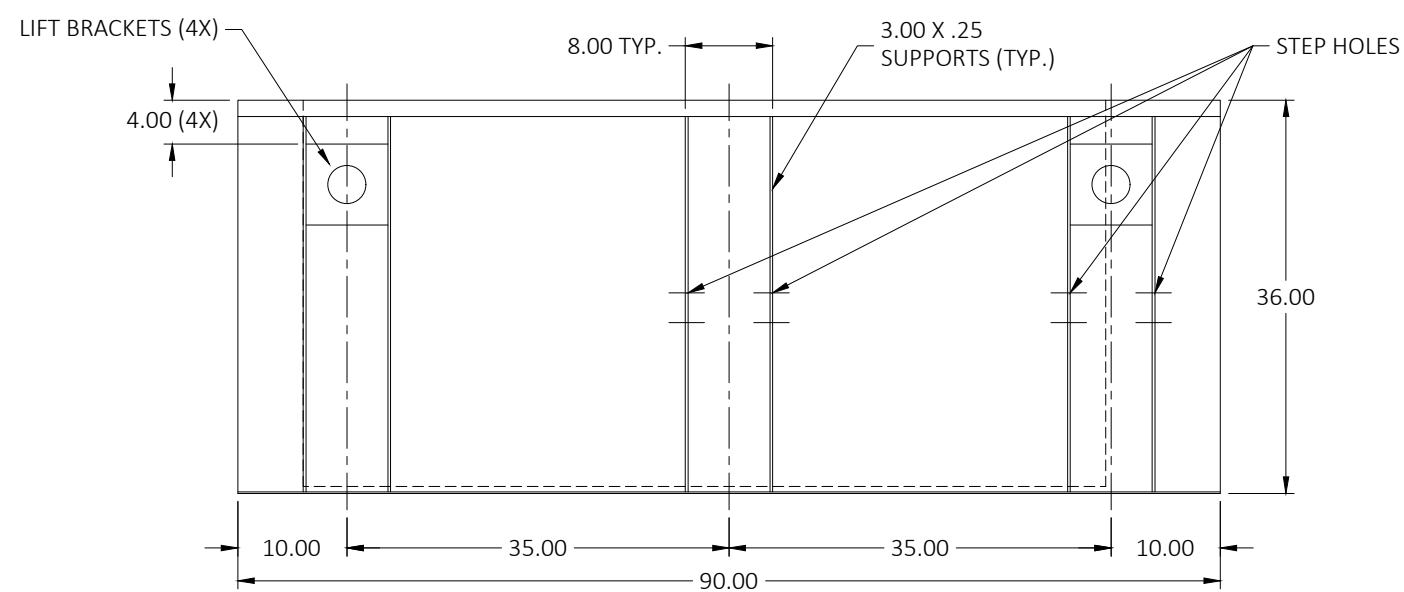


72HR / 450GL FUEL TANK  
 JD60-04FT4, JD80-03FT4  
 LV0 / LV1 / LV2 / LV3

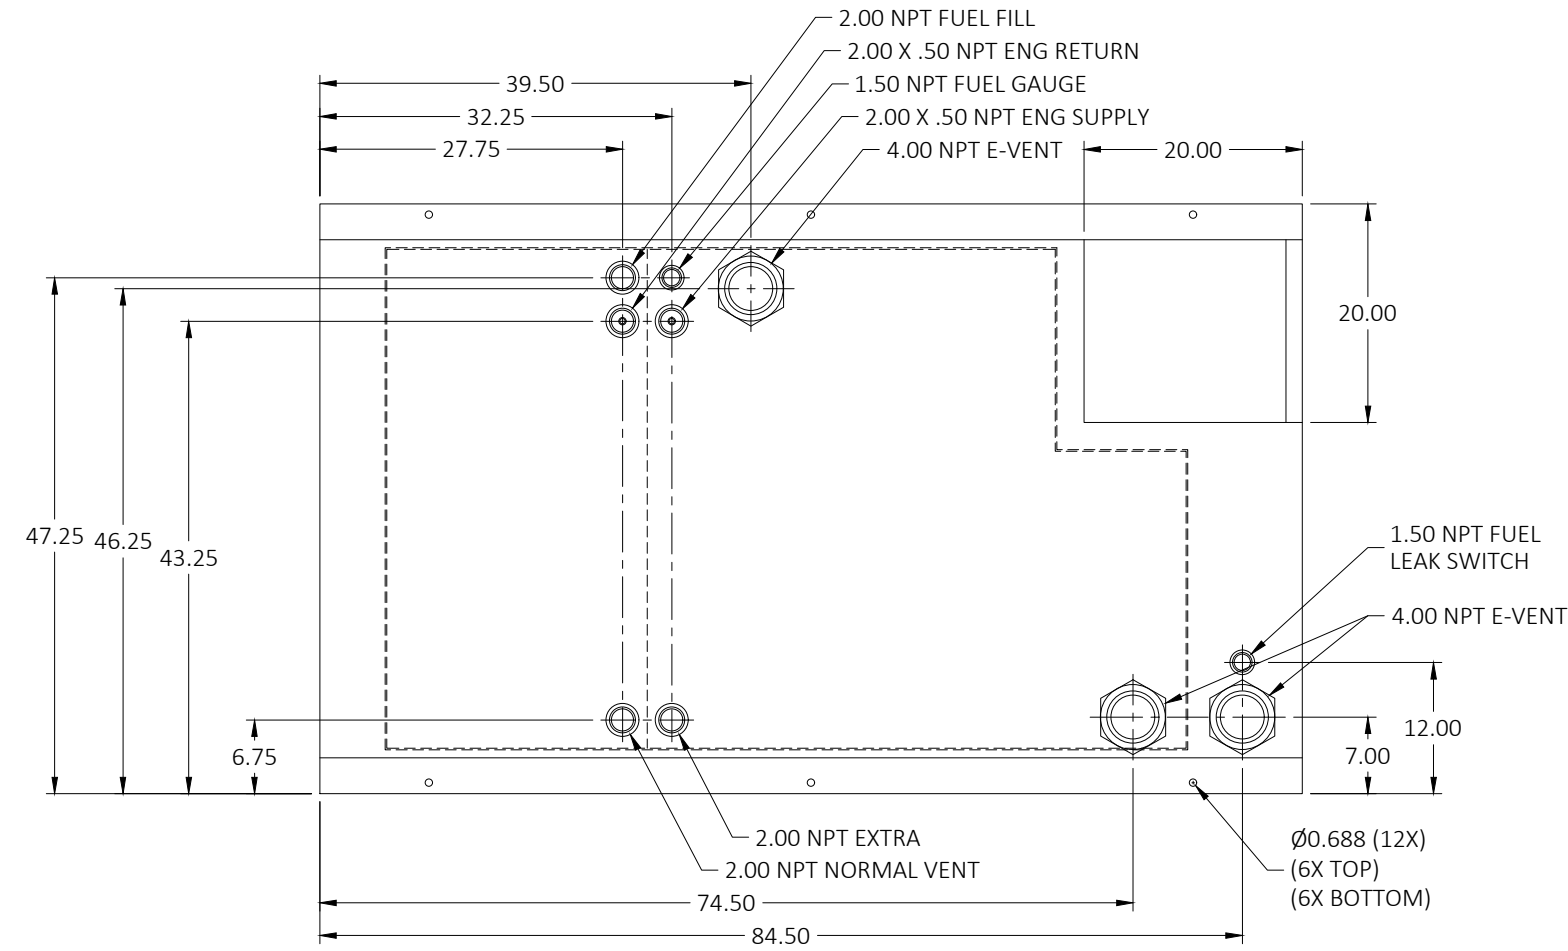

- NOTES:
1. MATERIAL: PER UL/ULC REQUIREMENTS
  2. SECONDARY CONTAINMENT TANK
  3. TANK TO INCLUDE:
    - FUEL SUPPLY/RETURN DIP TUBES
    - LIFTING/TIE-DOWN BRACKETS

MATERIAL: SEE NOTES FINISH: BLACK HAMMERED

REMOVE ALL BURRS AND SHARP EDGES  
 TOLERANCE UNLESS OTHER SPECIFIED:  
 FRACTIONAL: ± 1/32  
 ANGULAR: ± 1°  
 X.X = ± .1  
 X.XX = ± .03  
 X.XXX = ± .010  
 DIMENSIONS ARE IN INCHES  
 DO NOT SCALE DRAWING

R01	ADDED 2.00 NPT SPARE & MOVED BUNGS	08-27-20	ATB
LEVEL:	DESCRIPTION:	DATE:	BY:
REVISIONS:			
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BLUE STAR POWER SYSTEMS, INC. ANY REPRODUCTION, IN PART OR AS A WHOLE, WITHOUT THE WRITTEN PERMISSION IS PROHIBITED.			
<b>BLUE STAR</b> Power Systems Inc. 2250 CARLSON DRIVE, NORTH MANKATO, MINNESOTA 56003   1 507 345 1776			
TANK SB 450GL DW SC UL/ULC W/ STUB-UP			
	NAME	DATE	SIZE PART NUMBER:
	DRAWN BY: CRC	12-06-22	<b>B</b> 24392
	APPROVED: CRC	12-06-22	SCALE: NONE APPROX. WEIGHT: 1,700 LBS SHEET 1 OF 1