
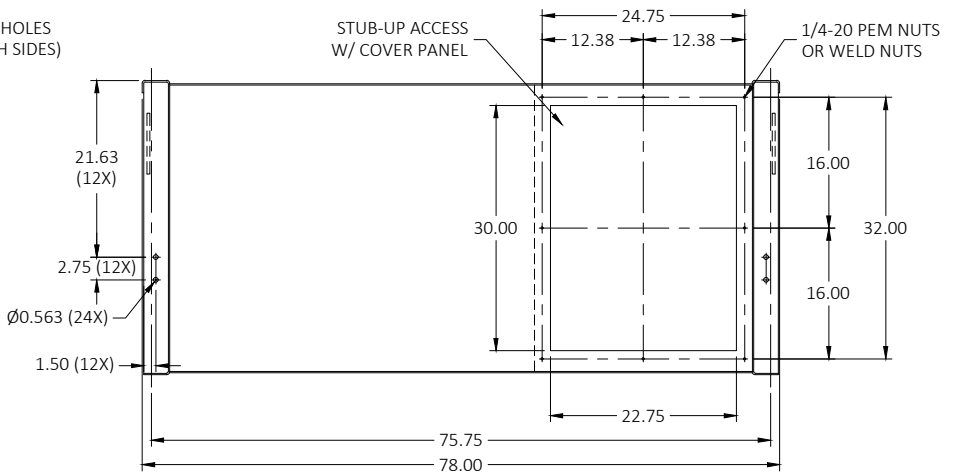
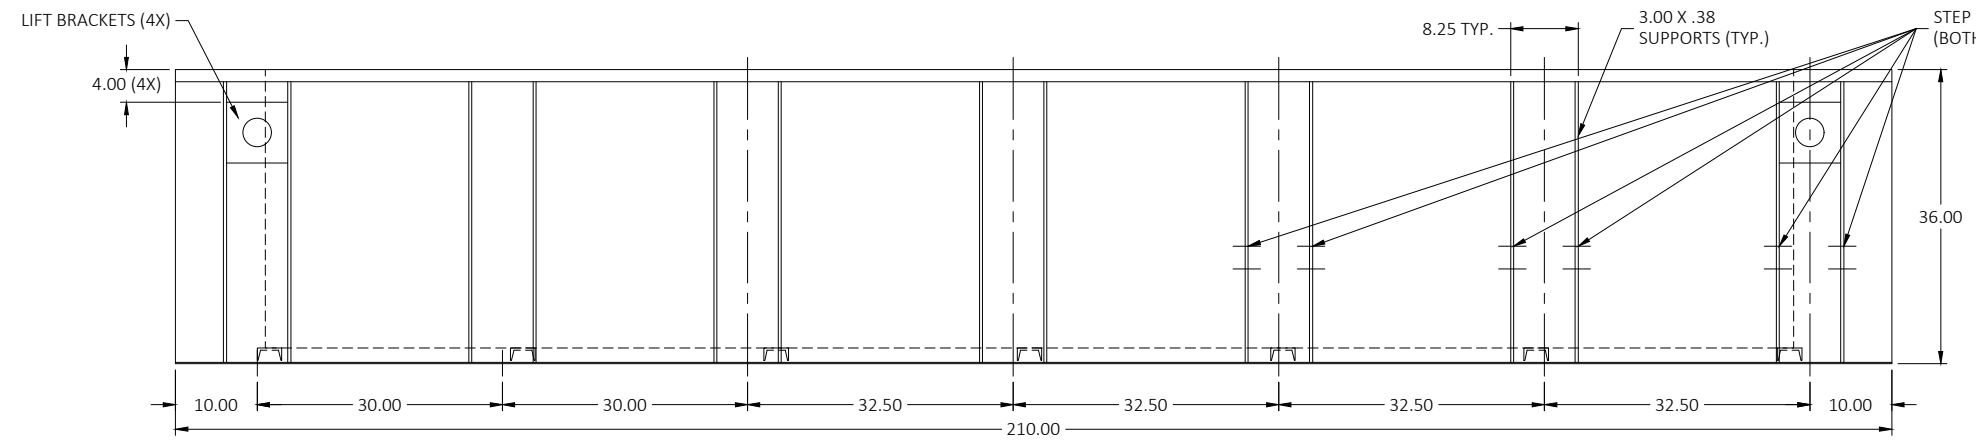


48HR / 1,800GL FUEL TANK  
 PD450-01, PD500-01  
 LV0 / LV1 / LV2 / LV3

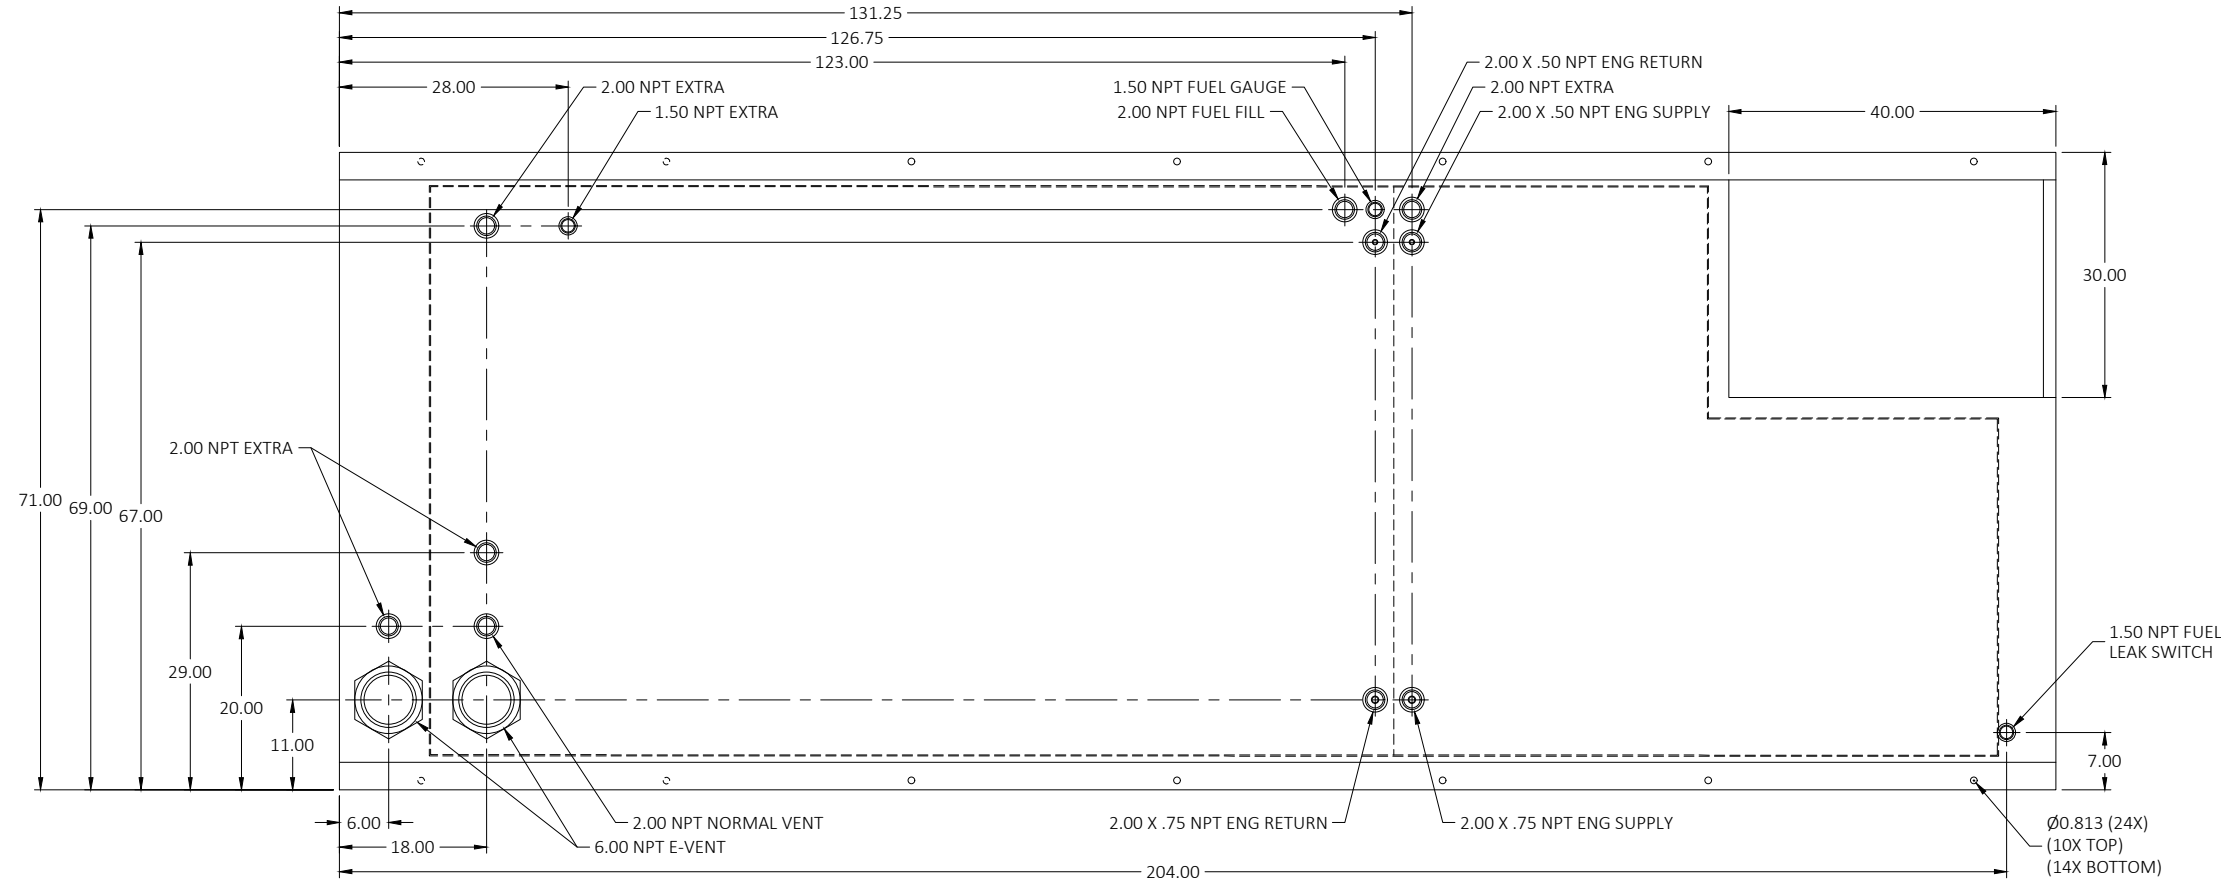

- NOTES:  
 1. MATERIAL: PER UL/ULC REQUIREMENTS  
 2. SECONDARY CONTAINMENT TANK  
 3. TANK TO INCLUDE:  
 -FUEL SUPPLY/RETURN DIP TUBES  
 -LIFTING/TIE DOWN BRACKETS

MATERIAL: SEE NOTES FINISH: BLACK HAMMERED

R02	MOVED FUEL LEAK SWITCH FITTING	12-15-21	ARS
LEVEL:	DESCRIPTION:	DATE:	BY:

REVISIONS:  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BLUE STAR POWER SYSTEMS, INC. ANY REPRODUCTION, IN PART OR AS A WHOLE, WITHOUT THE WRITTEN PERMISSION IS PROHIBITED.

REMOVE ALL BURRS AND SHARP EDGES  
 TOLERANCE UNLESS OTHER SPECIFIED:  
 FRACTIONAL: ± 1/32  
 ANGULAR: ± 1'  
 X.X = ± .1  
 X.XX = ± .03  
 X.XXX = ± .010



TANK SB 1800GL DW SC UL/ULC W/ STUB-UP

DIMENSIONS ARE IN INCHES	DRAWN BY:	CRC	12-08-22	SCALE: NONE	APPROX. WEIGHT: 5,500 LBS	SHEET 1 OF 1
	APPROVED:	CRC	12-08-22			
DO NOT SCALE DRAWING	NAME:	CRC	DATE:	12-08-22	SIZE:	B
	PART NUMBER:	23590				