
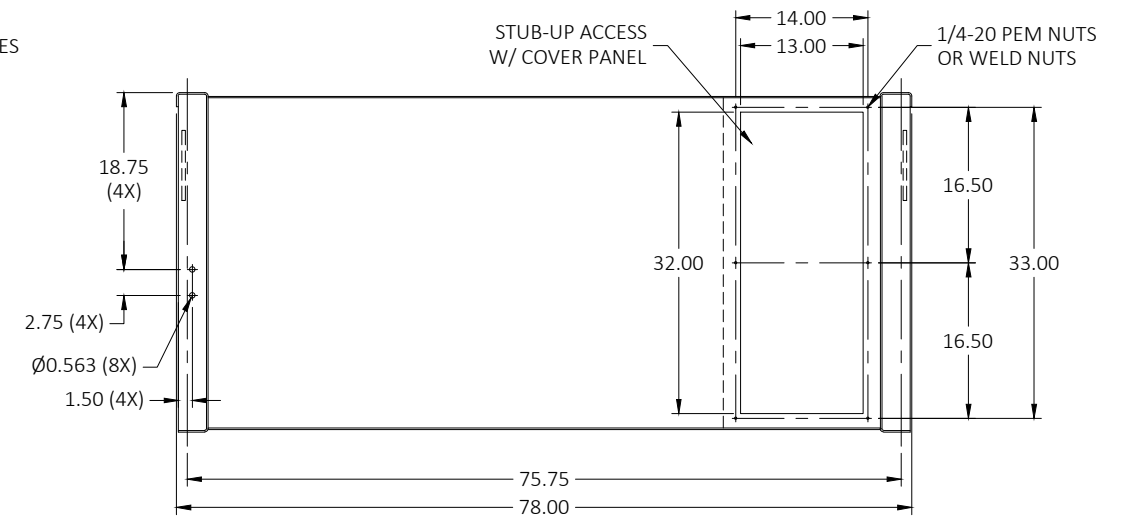
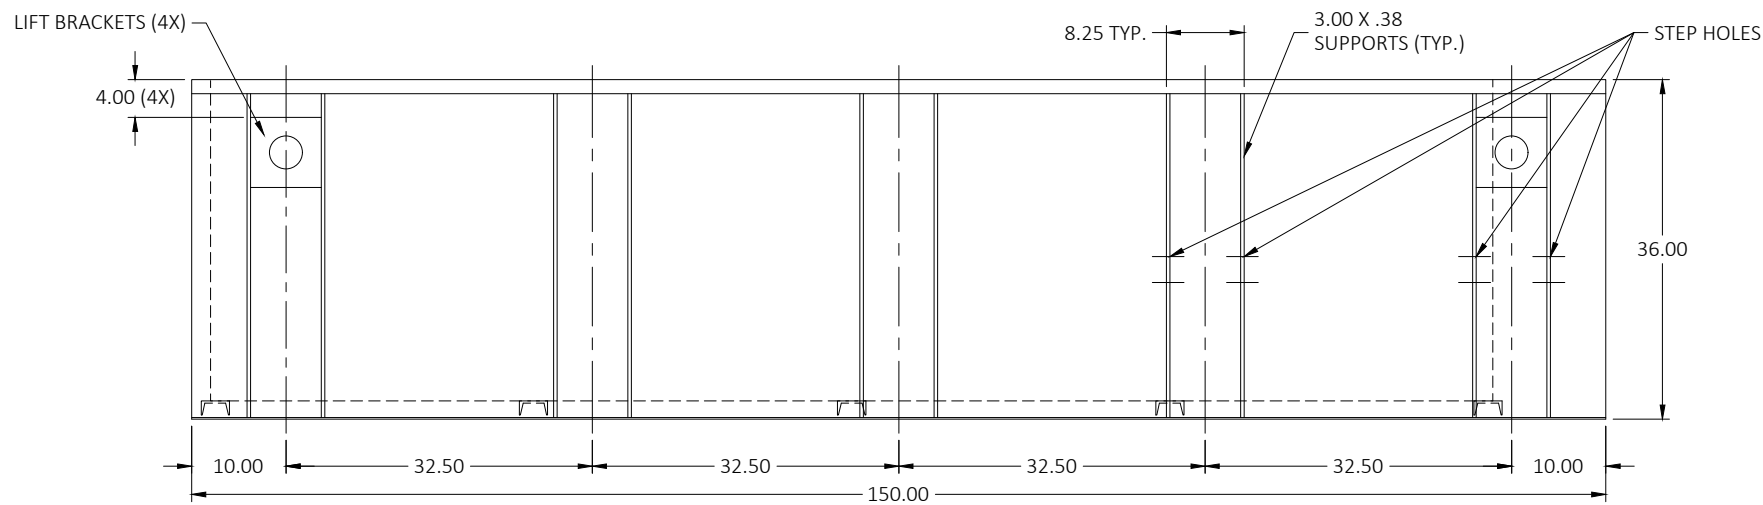


DRAWING: 23585

24HR / 1,300GL FUEL TANK

PD750-01

LV0 / LV1 / LV2 / LV3

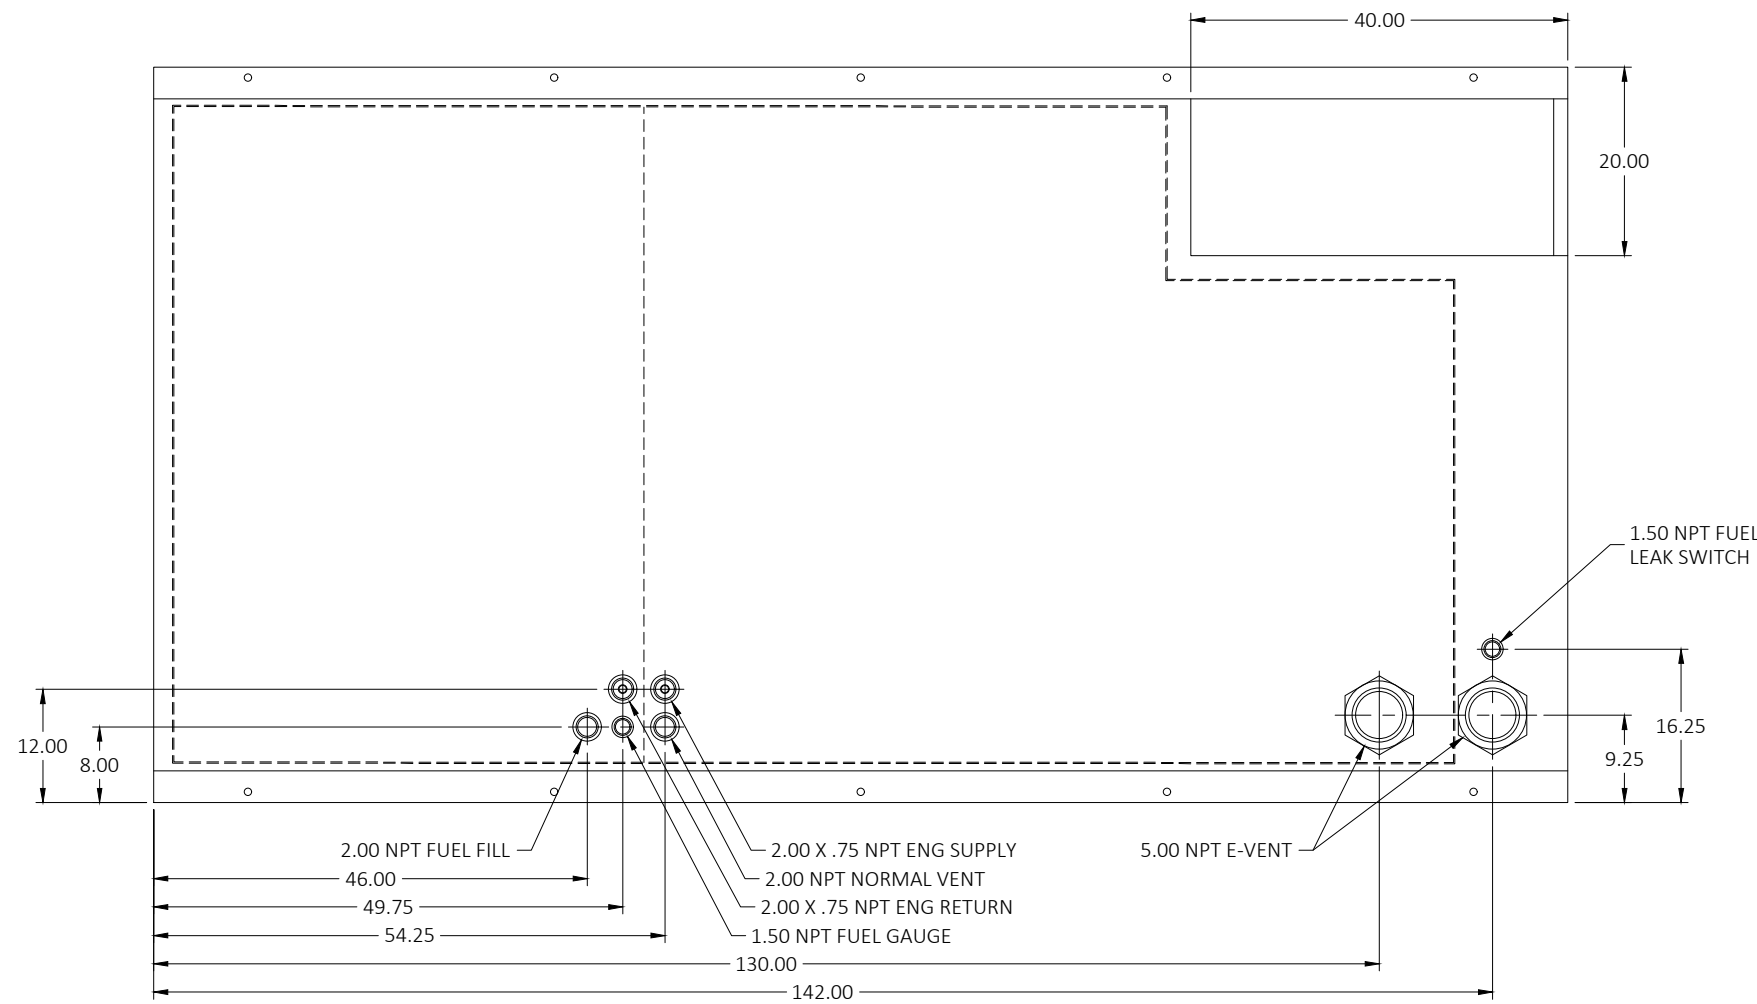

- NOTES:
1. MATERIAL: PER UL/ULC REQUIREMENTS
 2. SECONDARY CONTAINMENT TANK
 3. TANK TO INCLUDE:
 - FUEL SUPPLY/RETURN DIP TUBES
 - LIFTING/TIE DOWN BRACKETS

MATERIAL: SEE NOTES

FINISH: BLACK HAMMERED

REMOVE ALL BURRS AND SHARP EDGES

TOLERANCE UNLESS OTHER SPECIFIED:

FRACTIONAL: $\pm \frac{1}{32}$
 ANGULAR: $\pm 1'$
 X.X = $\pm .1$
 X.XX = $\pm .03$
 X.XXX = $\pm .010$

DIMENSIONS ARE IN INCHES

DO NOT SCALE DRAWING

R03	MOVED FITTING CLUSTER	02-21-22	CRC
LEVEL:	DESCRIPTION:	DATE:	BY:
REVISIONS:			
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF BLUE STAR POWER SYSTEMS, INC. ANY REPRODUCTION, IN PART OR AS A WHOLE, WITHOUT THE WRITTEN PERMISSION IS PROHIBITED.			
2250 CARLSON DRIVE, NORTH MANKATO, MINNESOTA 56003 1 507 345 1776			
TANK SB 1300GL DW SC UL/ULC W/ STUB-UP			
	NAME	DATE	SIZE PART NUMBER:
	DRAWN BY: CRC	12-09-22	B 23585
	APPROVED: CRC	12-09-22	SCALE: NONE APPROX. WEIGHT: 3,550 LBS SHEET 1 OF 1